

2014 Highlighted Water Projects

Fire Hydrants Annual Test

The Bella Vista Village Water Department completed its annual maintenance and testing of 1,439 fire hydrants and 66 pressure reducing valves. Fire hydrants and pressure reducing valves are inspected and maintained on an annual basis. Also, 345 fire hydrants were painted and color coded. Fire hydrant flow testing is conducted on a five-year rotation. Flow tests for the 345 hydrants in District No. 2 were complete in 2014.

Waterline Replacement Projects

Close to 4,800 feet of waterline were replaced throughout Bella Vista Village in 2014.

Line replacement included:

- 750 feet of 10-inch water main on Maltby Drive.
- 54 feet of 6-inch water main on Mercy Way.
- 1220 feet of 6-inch water main on Murphy Drive, Caywood Drive Weybridge Drive and Letchworth Drive .
- 100 feet of 8-inch water main on Granshire Drive.

The lines were replaced by water department personnel, who also replaced 910 feet of 1-inch and 860 feet of 2-inch galvanized waterlines throughout the village.

AC Pipe Evaluation Study

University of Arkansas AC pipe evaluation to conclude this year. BVVPOA Water Utility crews have been taken sections of Pipe from the water system to the University of Arkansas to undergo various pipe tests to evaluate how the pipe in the Village's water system is performing. The study is assisting in determining if the integrity of the pipe materials are still viable as they exist today compared to when they were initially installed. It will also allow the water utility department to know and understand how the pipe has held up throughout the years and whether it needs to be replaced.

Improvement Projects Scheduled for 2015

The Water Utility department will be installing aeration (tank mixer) units in 3 water storage tanks to improve water quality. Water main replacement on Nantucket Drive. The Arkansas 279 pump station up-grade project was delayed in 2014 and will be re-evaluated to transfer water from the west side of the system to the central portion of the system. The residential water service metering system will be under evaluation as new technologies improve.

Consumer Confidence Report for 2014

Enclosed is the 2014 Consumer Confidence Report (CCR). Since Bella Vista Village has dual water supply sources, this brochure contains a map, located on the inside, showing each customer's service area. Customers west of Arkansas 279 receive their water from the Benton/Washington Regional Public Water Authority supply line. Customers east of Arkansas 279 receive their water from the Bentonville supply line, which comes from the Beaver Water District. Should you have any questions concerning the CCR please contact Bella Vista Village's Water Department, at (479) 855-5060. On behalf of the entire water department, we look forward to continuing to serve you.


Mike Taggart

Water Director

Bella Vista Village Property Owners Association
MikeT@BellaVistaPOA.com



Water Department: (479) 855-5060
Billing Information: (479) 855-5085
www.BellaVistaPOA.com

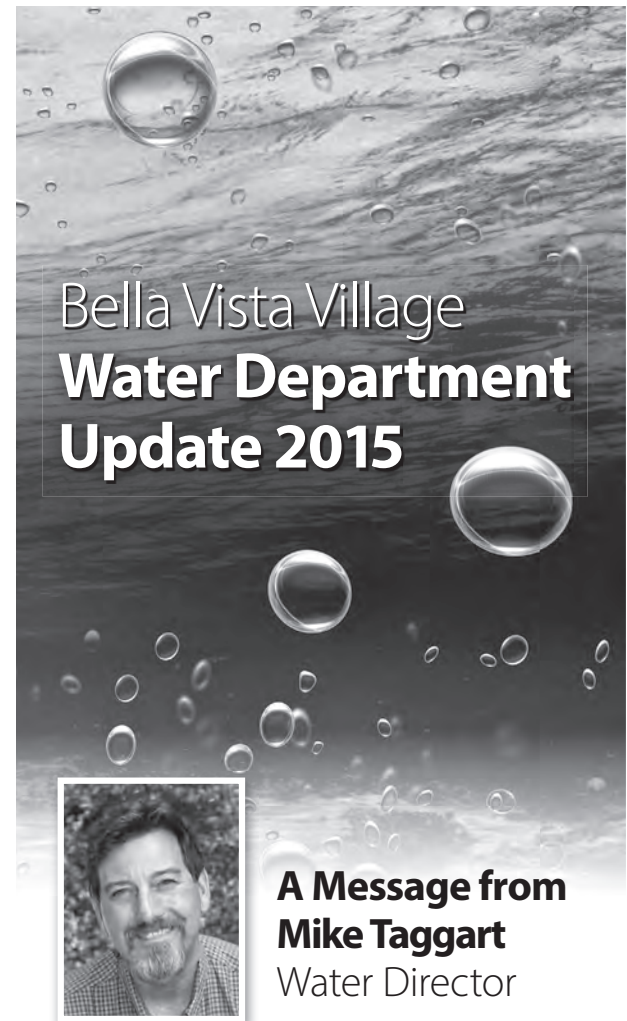

The Bella Vista Village Water Department would like to take this opportunity to thank its valued customers. It has been our pleasure serving you in 2014.


The water department continues to make significant improvements to the community's extensive water system in order to provide customers with safe, reliable drinking water at the most affordable rates possible.

We look forward to continuing to improve our system and assisting you in the future.

Water Sources

Customers west of Arkansas 279 receive their water from the Benton/Washington Regional Public Water Authority supply line.

Customers east of Arkansas 279 receive their water from the Bentonville supply line.

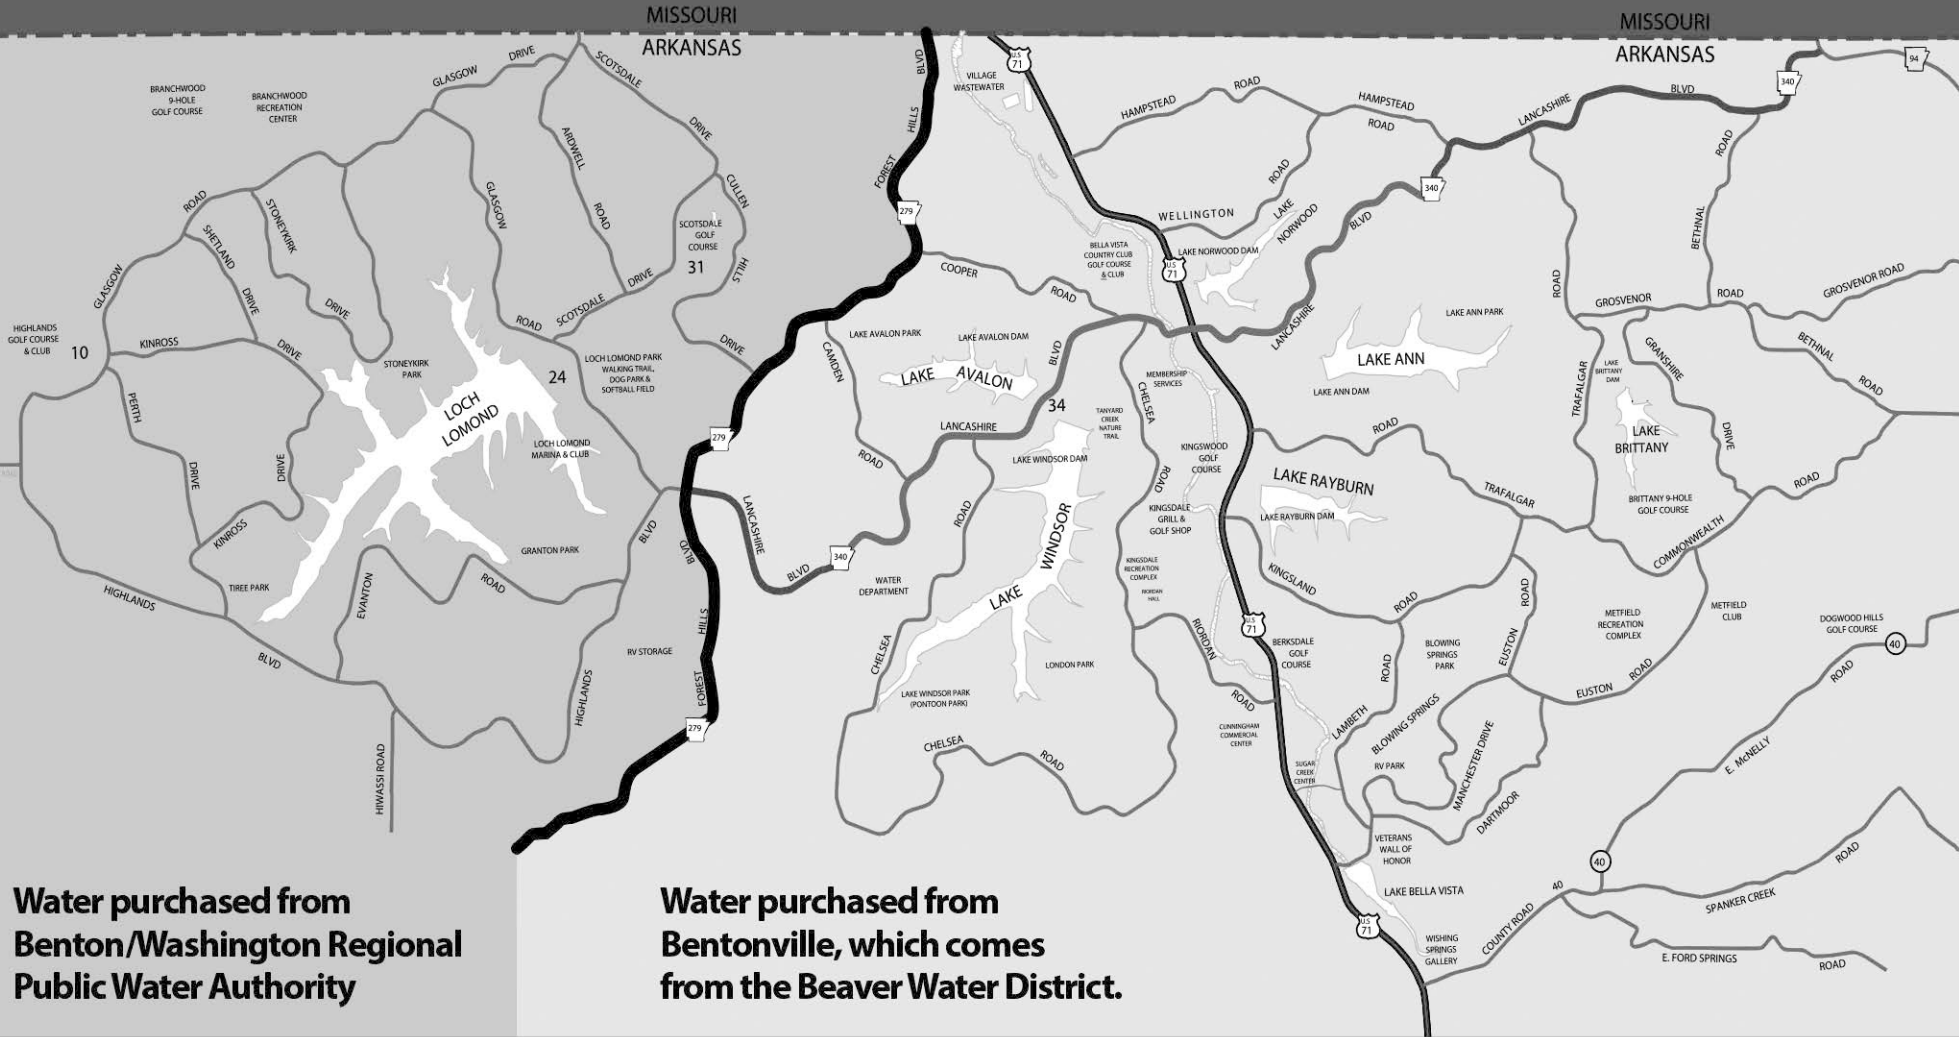

Water purchased from Benton/Washington Regional Public Water Authority

Water purchased from Bentonville, which comes from the Beaver Water District.